

VARIMETER

Current Relay

BA 9053, MK 9053N



0221 64 0

BA 9053

MK 9053N


Your Advantages

- Preventive maintenance
- For better productivity
- Quicker fault locating
- Precise and reliable


Features

- According to IEC/EN 60255-1, IEC/EN 60947-1
- To: monitor DC and AC
- BA 9053 with measuring ranges from 2 mA to 25 A
- BA 9053 optionally with 3 measuring ranges 0.1 up to 25 A
- MK 9053N with measuring ranges from 2 mA up to 10 A
- High overload possible
- Input frequency up to 5 kHz
- Galvanic separation between auxiliary circuit - measuring circuit
- Auxiliary supply AC/DC; BA 9053 with AC
- BA 9053 optionally with start-up delay (MK = standard)
- with time delay, up to max. 100 sec
- BA 9053 optionally with safe separation to IEC/EN 61140
- MK 9053N optionally with remote potentiometer
- As option with manual reset
- Option with fixed settings possible
- LED indicators for operation and contact position
- MK 9053N as option with pluggable terminal blocks for easy exchange of devices
 - With screw terminals
 - Or with cage clamp terminals
- Width BA 9053: 45 mm
- Width MK 9053N: 22.5 mm


Circuit Diagrams

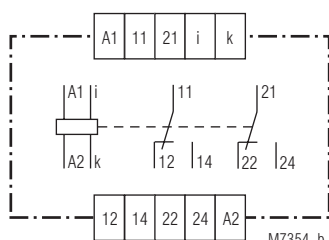


BA 9053

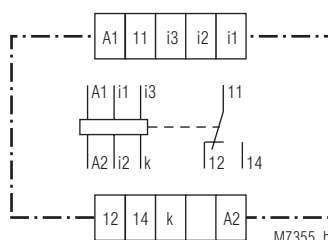

BA 9053/4__ z. B.:
 Terminals i1/k: 0.1 ... 1 A
 Terminals i2/k: 0.5 ... 5 A
 Terminals i3/k: 1 ... 10 A

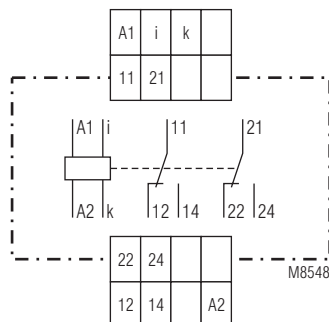

MK 9053N

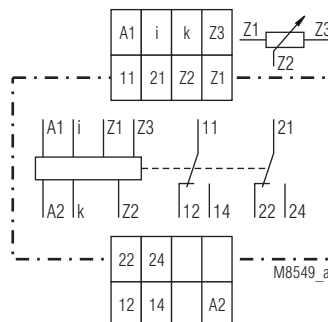

MK 9053N/1__

Connection Terminals

Terminal designation	Signal description
A1, A2	Auxiliary voltage
i, k	Current measuring input
11, 12, 14	1st changeover contact
21, 22, 24	2nd changeover contact
at MK 9053/1__: Z1, Z2, Z3	Remote potentiometer for response value

Safety Notes

Please observe when connecting a remote potentiometer to MK 9053N/1__:



Measuring circuit and remote potentiometer not galvanically separated. The voltage on measuring circuit i, k / PE has connection to the remote potentiometer. The remote potentiometer has to be connected volt- and ground-free.

Approvals and Markings



¹⁾ Approval not for all variants

Applications

- Monitoring current in AC or DC systems
- For industrial and railway applications

Function

The relays measure the arithmetic mean value of the rectified measuring current. The AC units are adjusted to the r.m.s value. They have settings for response value and hysteresis. The units work as overcurrent relays but can also be used for undercurrent detection. The hysteresis is dependent on the response value.


2 time delays are possible in different variants:

The start up delay t_a operates only when connecting the auxiliary supply. It disables tripping e.g. caused by an increased starting current of a motor. The response delay t_v is active after exceeding a response value. On overcurrent relays the delay is active when the current goes over the tripping value, on undercurrent relays when the current drops below the hysteresis value.

Indicators


- Green LED: On, when auxiliary supply connected
- Yellow LED: On, when output relay activated

Function Diagram without Start-up Delay

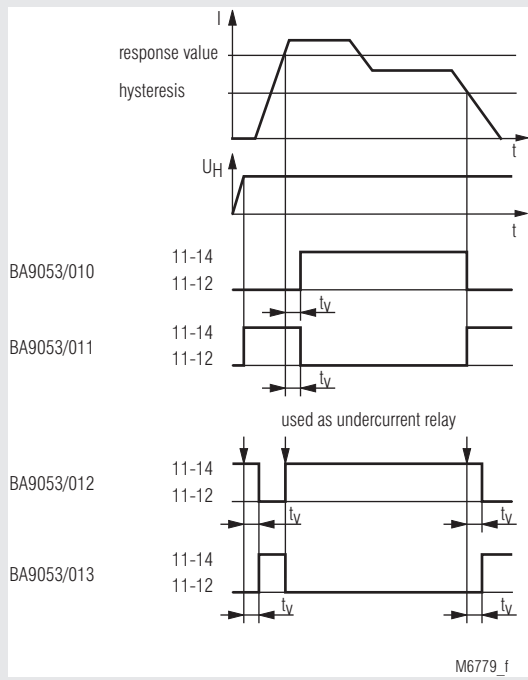

M6779_f

Function Diagram with Start-up Delay

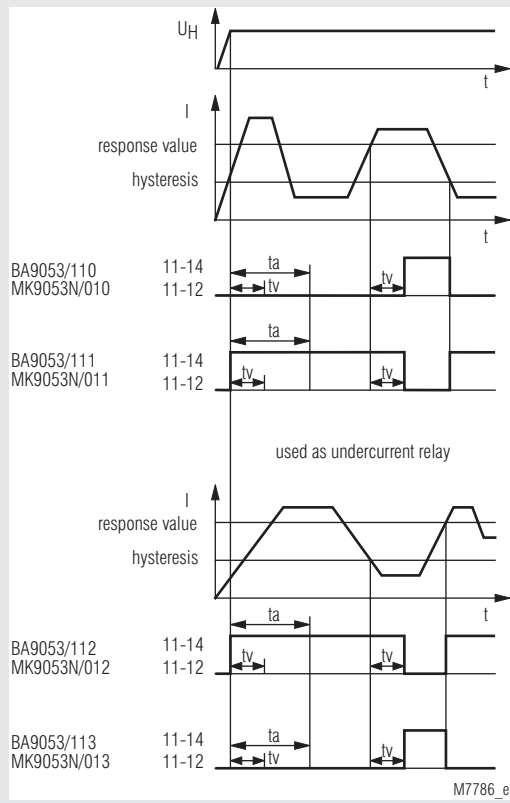

M7786_e

On model BA 9053/6_ _ with manual reset the contacts remain in the fault state after detecting a fault or after t_o has elapsed. The contacts are reset by disconnecting the supply voltage.

Technical Data

Input (i, k)

BA 9053 for AC and DC					
Measuring range ^{*)}		RM (internal measur- ing resistor (shunt))	Max. perm. cont. current		Max. perm. current 3 s On, 100 s Off
AC	DC		Device mounted without distance		
2 - 20 mA	1.8 - 18 mA	1.5 Ω	0.7 A		1 A
20 - 200 mA	18 - 180 mA	0.15 Ω	2 A		4 A
30 - 300 mA	27 - 270 mA	0.1 Ω	2.5 A		8 A
50 - 500 mA	45 - 450 mA	0.1 Ω	2.5 A		8 A
80 - 800 mA	72 - 720 mA	40 mΩ	4 A		12 A
0.1- 1 A	0.09 - 0.9 A	30 mΩ	4 A		12 A
0.5- 5 A	0.45 - 4.5 A	6 mΩ	10 A		30 A
1 - 10 A	0.9 - 9 A	3 mΩ	20 A		40 A
1.5- 15 A	1.35 - 13.5 A	3 mΩ	25 A		40 A
2 - 20 A	1.8 - 18 A	3 mΩ	25 A		40 A
2.5 - 25 A	2.25 - 22.5 A	3 mΩ	25 A		40 A

* DC or AC current 50 ... 5000 Hz
(other frequency ranges of 10 ... 5000 Hz, e.g. 16 ²/₃ Hz on request)

BA 9053/4 __ with 3 measuring ranges:			
Range:	Terminals i1/k	Terminals i2/k	Terminals i3/k
AC 20 mA / 200 mA / 1A:	AC 2.0 ... 20 mA	AC 20 ... 200 mA	AC 0.1 ... 1 A
	DC 1.8 ... 18 mA	DC 18 ... 180 mA	DC 0.09 ... 0.9 A
AC 1 / 5 / 10A:	AC 0.1 ... 1 A	AC 0.5 ... 5 A	AC 1.0 ... 10 A
	DC 0.09 ... 0.9 A	DC 0.45 ... 4.5 A	DC 0.9 ... 9 A
AC 5 / 10 / 25A:	AC 0.5 ... 5 A	AC 1.0 ... 10 A	AC 2.5 ... 25 A
	DC 0.45 ... 4.5 A	DC 0.9 ... 9 A	DC 2.25 ... 22.5 A

MK 9053N with 1 Measuring range for AC and DC					
Measuring range ^{*)}		RM (internal measur- ing resistor (shunt))	max. perm. cont. current		max. perm. current 3 s On, 100 s Off
AC	DC		Device mount. without distance	with 5 mm dis- tance	
2 - 20 mA	1.8 - 18 mA	1.5 Ω	0.5 A	0.7 A	1 A
20 - 200 mA	18 - 180 mA	0.15 Ω	1.5 A	2 A	4 A
30 - 300 mA	27 - 270 mA	0.1 Ω	2 A	2.5 A	8 A
50 - 500 mA	45 - 450 mA	0.1 Ω	2 A	2.5 A	8 A
0.1- 1 A	0.09 - 0.9 A	30 mΩ	3 A	4 A	8 A
0.5- 5 A	0.45 - 4.5 A	6 mΩ	8 A	11 A	20 A
1 - 10 A	0.9 - 9 A	3 mΩ	12 A	15 A	20 A

* DC or AC current 50 ... 5000 Hz
(Other frequency ranges of 10 ... 5000 Hz, e.g. 16 ²/₃ Hz on request)

Extending of measuring range:

For DC currents exceeding the largest measuring range, the measuring range 15 ... 150 mV or 6 ... 60 mV of the BA 9054 and MK 9054N can be used with external shunt.
For AC current exceeding the largest measuring range a current transformer can be used. For Example with secondary winding of 1 A or 5 A together with the BA 9053 or MK 9053N. The nominal load of the CT should be ≥ 0.5 VA.

Measuring principle:

Arithmetic mean value

Adjustment:

The AC-devices can also monitor DC current. The scale offset in this case is:

$$(\bar{I} = 0.90 I_{\text{eff}})$$

Temperature influence:

$$< 0.05 \% / K$$

Technical Data

Setting Ranges

Setting

Response value: Infinite variable 0.1 I_N ... 1 I_N
relative scale

Hysteresis
at AC: Infinite variable 0.5 ... 0.98 of setting value
at DC: Infinite variable 0.5 ... 0.96 of setting value

Accuracy:

Response value at

Potentiometer right stop (max): 0 ... + 8 %

Potentiometer left stop (min): - 10 ... + 8 %

Repeat accuracy

(constant parameter): $\leq \pm 0.5 \%$

Recovery time

at devices with manual reset

(Reset by braking
of the auxiliary voltage)

BA 9053/6 __; MK 9053N/6 __: ≤ 1 s

(dependent to function and auxiliary voltage)

Time delay t_v :

Infinite variable at logarithmic scale
from 0 ... 20 s, 0 ... 30 s, 0 ... 60 s, 0 ... 100 s
setting 0 s = without time delay

Start-up delay t_a :

BA 9053/1 __: 1 ... 20 s; 1 ... 60 s; 1 ... 100 s,
adjustable on logarithmic scale.
 t_a is started when the supply voltage
is connected. During elapse of time
the output contact is in good state

MK 9053N: 0.1 ... 20 s; 0.1 ... 60 s; 0.1 ... 100 s

Auxiliary voltage U_H (A1, A2) for wide voltage range

BA 9053, MK 9053N:		
Nominal voltage	Voltage range	Frequency range
AC/DC 24 ... 80 V	AC 18 ... 100 V	45 ... 400 Hz; DC 48 % W
	DC 18 ... 130 V	W $\leq 5 \%$
AC/DC 80 ... 230 V	AC 40 ... 265 V	45 ... 400 Hz; DC 48 % W
	DC 40 ... 300 V	W $\leq 5 \%$

BA 9053		
Nominal voltage	Voltage range	Frequency range
DC 12 V	DC 10 ... 18 V	battery voltage

Nominal consumption: 4 VA; 1.5 W at AC 230 V Rel. energized
1 W at DC 80 V Rel. energized

Auxiliary voltage U_H (A1, A2) for mono voltages

Nominal voltage: AC 24, 42, 110, 127, 230, 400 V
Voltage range: 0.8 ... 1.1 U_H
Nominal frequency: 50 / 60 Hz
Frequency range: $\pm 5 \%$
Nominal consumption: 2.5 VA

Technical Data

Output

Contacts

BA 9053:	2 changeover contacts
MK 9053N:	2 changeover contacts

Thermal current I_{th} :

BA 9053:	2 x 5 A
MK 9053N:	2 x 4 A

Switching capacity

BA 9053		
to AC 15:		
NO contact:	2 A / AC 230 V	IEC/EN 60947-5-1
NC contact:	1 A / AC 230 V	IEC/EN 60947-5-1
MK 9053N		
to AC 15:	1.5 A / AC 230 V	IEC/EN 60947-5-1
BA 9053, MK 9053N		
to DC 13:	1 A / DC 24 V	IEC/EN 60947-5-1

Electrical life

BA 9053	
at 3 A, AC 230 V $\cos \varphi = 1$:	2 x 10 ⁵ switching cycles
MK 9053N	
bei 2 A, AC 230 V $\cos \varphi = 1$:	10 ⁵ switching cycles

Short-circuit strength

max. fuse rating:	6 A gG / gL	IEC/EN 60947-5-1
-------------------	-------------	------------------

Mechanical life

BA 9053:	30 x 10 ⁶ switching cycles
MK 9053N:	20 x 10 ⁶ switching cycles

General Data

Operating mode: Continuous operation

Temperature range:

BA 9053 (operation):	
≤ 10 A:	- 40 ... + 60°C
≥ 15 A:	- 40 ... + 50°C
	(higher temperature with limitations on request)

MK 9053N (operation):	
	- 40 ... + 50°C
	(higher temperature with limitations on request)

BA 9053, MK 9053N (storage): - 40 ... + 70°C

Altitude: < 2000 m

Clearance and creepage distances

Rated impulse voltage / pollution degree		
BA 9053 meas. range ≤ 10 A:		
Aux. voltage / measuring input:	6 kV / 2	IEC 60664-1
Auxiliary voltage / contacts:	6 kV / 2	IEC 60664-1
Measuring input / contacts:	6 kV / 2	IEC 60664-1
Contacts 11, 12, 14 / 21, 22, 24:	4 kV / 2	IEC 60664-1
BA 9053 meas. range ≥ 15 A:	4 kV / 2	IEC 60664-1
MK 9053N:	4 kV / 2	IEC 60664-1

EMC

Electrostatic discharge:	8 kV (air)	IEC/EN 61000-4-2
HF irradiation		
80 MHz ... 1 GHz:	20 V/m	IEC/EN 61000-4-3
1 GHz ... 2.7 GHz:	10 V/m	IEC/EN 61000-4-3
Fast transients:	4 kV	IEC/EN 61000-4-4

Surge voltages between

wires for power supply:	2 kV	IEC/EN 61000-4-5
between wire and ground:	4 kV	IEC/EN 61000-4-5
HF wire guided:	10 V	IEC/EN 61000-4-6
Interference suppression:	Limit value class B	EN 55011

Degree of protection

Housing:	IP 40	IEC/EN 60529
Terminals:	IP 20	IEC/EN 60529

Housing: Thermoplastic with V0 behaviour according to UL subject 94

Vibration resistance: Amplitude 0.35 mm IEC/EN 60068-2-6 frequency 10 ... 55 Hz

Technical Data

Climate resistance

BA 9053		
≤ 10 A:	40 / 060 / 04	IEC/EN 60068-1
≥ 15 A:	40 / 050 / 04	IEC/EN 60068-1
MK 9053N:	20 / 060 / 04	IEC/EN 60068-1

Terminal designation:

EN 50005

Wire connection

BA 9053: 2 x 2.5 mm² solid or

2 x 1.5 mm² stranded wire with sleeve

MK 9053N:

Screw terminals

(integrated):

1 x 4 mm² solid or
1 x 2.5 mm² stranded ferruled (isolated) or
2 x 1.5 mm² stranded ferruled (isolated) or
2 x 2.5 mm² solid

Insulation of wires or sleeve length:

8 mm

Plug in with

screw terminals

max. cross section for connection:

1 x 2.5 mm² solid or
1 x 2.5 mm² stranded ferruled (isolated)

Insulation of wires or sleeve length:

8 mm

Plug in with

cage clamp terminals

max. cross section for connection:

1 x 4 mm² solid or
1 x 2.5 mm² stranded ferruled (isolated)

min. cross section for connection:

0.5 mm²

Insulation of wires or sleeve length:

12 ±0.5 mm

Wire fixing:

BA 9053: Plus-minus terminal screws M3.5 with self-lifting clamping piece IEC/EN 60999-1
MK 9053N: Plus-minus terminal screws M3.5 box terminals with wire protection or cage clamp terminals

Stripping length:

Fixing torque:

0.8 Nm

Mounting:

Weight

BA 9053:	AC-device: 280 g
	AC/DC-device: 200 g
MK 9053N:	150 g

Dimensions

Width x height x depth

BA 9053:	45 x 75 x 120 mm
MK 9053N:	22.5 x 90 x 97 mm

Classification to DIN EN 50155 for BA 9053

Vibration and

shock resistance: Category 1, Class B IEC/EN 61373

Ambient temperature: T1, T2 compliant
T3 and TX with operational limitations

Protective coating of the PCB: No

UL-Data

Auxiliary voltage $U_H(A1, A2)$

BA 9053: AC 24, 42, 48, 110, 115, 120 V

Thermal current I_{th} :

BA 9053: 2 x 5 A

MK 9053N: 2 x 4 A

Clearance and creepage distances

BA 9053, MK 9053N: 4 kV / 2 IEC 60 664-1

HF irradiation

BA 9053 (80 MHz ... 2.7 GHz) 10 V/m IEC/EN 61 000-4-3

Switching capacity: Pilot duty B150

Ambient temperature: - 40 ... + 60°C



Technical data that is not stated in the UL-Data, can be found in the technical data section.

CCC-Data

Thermal current I_{th} :

BA 9053: 5 A

MK 9053N: 4 A

Switching capacity

BA 9053

to AC 15: 2 A / AC 230 V IEC/EN 60947-5-1

MK 9053N

to AC 15: 1,5 A / AC 230 V IEC/EN 60947-5-1

BA 9053, MK 9053N

to DC 13: 1 A / DC 24 V IEC/EN 60947-5-1



Technical data that is not stated in the CCC-Data, can be found in the technical data section.

Standard Type

BA 9053/010 AC 1.5 ... 15 A AC/DC 80 ... 230 V

Article number: 0057178

• for Overcurrent monitoring

• Measuring range: AC 1.5 ... 15 A

• Auxiliary voltage U_H : AC/DC 80 ... 230 V

• Time delay by I_{an} : 0 ... 20 s

• Width: 45 mm

BA 9053/012 AC 1.5 ... 15 A AC/DC 80 ... 230 V

Article number: 0061256

• for Undercurrent monitoring

• Measuring range: AC 1.5 ... 15 A

• Auxiliary voltage U_H : AC/DC 80 ... 230 V

• Time delay by I_{ab} : 0 ... 20 s

• Width: 45 mm

MK 9053N.12/010 AC 0.5 ... 5 A AC/DC 80 ... 230 V t_v 0 ... 20 s t_a 0.1 ... 20 s

Article number: 0063176

• for Overcurrent monitoring

• Measuring range: AC 0.5 ... 5 A

• Auxiliary voltage U_H : AC/DC 80 ... 230 V

• Time delay by t_v : 0 ... 20 s

• Start up delay t_a : 0.1 ... 20 s

• Width: 22.5 mm

Variant


BA 9053/3_ _: For switching small loads of 10 mVA ... 12 VA
resp. 10 mW ... 12 W in the ranges
2 ... 60 V und 2 ... 300 mA.

The device is also suitable for switching the maximum switching current. However, this will burn off the gold plating of the contacts, so that switching of small loads is no longer possible afterwards.


Ordering Example for Variants

<p>BA 9053 / /61 AC 1 ... 10 A AC 24 V 0 ... 20 s 1 ... 100 s</p>	<p>MK 9053N / AC 0,1 ... 1 A AC/DC 80 ... 230 V 0 ... 20 s 0,1 ... 20 s</p>
<p>Start up delay t_a Time delay t_v Auxiliary voltage Measuring range</p> <p>With UL-approval</p> <p>10 Overcurrent relay energized on trip time delay at setting value</p> <p>11 Overcurrent relay de-energized on trip time delay at setting value</p> <p>12 Undercurrent relay de-energized on trip time delay at hysteresis value</p> <p>13 Undercurrent relay energized on trip time delay at hysteresis value</p> <p>0 Standard version</p> <p>1 With start up delay t_a</p> <p>130 Overcurrent relay energized on trip time delay at setting value with start up delay t_a safe separation up to 10 A</p> <p>2 With safe electrical separation of input- and output circuit according to DIN 61140</p> <p>Meas. range up to ≤ 10 A: DIN EN 60947-1; 4 kV/2 in relation of overvoltage category III with basic insulation to DIN EN 60664-1 of 4 kV;</p> <p>Meas. range up to ≥ 15 A: overvoltage category II with basic insulation of 2.5 kV</p> <p>3 With 5 μm gold plated contacts</p> <p>4 With 3 current ranges 1 C/O contact</p> <p>431 With 3 current ranges 1 C/O contact, with safe separation up to 10 A</p> <p>5 With forcibly guided contacts</p> <p>6 With manual reset, resetting by disconnecting the power supply</p> <p>Type</p>	<p>Start up delay t_a Time delay t_v Auxiliary voltage Measuring range</p> <p>10 Overcurrent relay energized on trip</p> <p>11 Overcurrent relay de-energized on trip</p> <p>12 Undercurrent relay de-energized on trip</p> <p>13 Undercurrent relay energized on trip</p> <p>0 Standard version without remote potentiometer</p> <p>1 Standard version with remote potentiometer (response-value) Z1, Z2, Z3 for 470 kΩ at this version there is no potentiometer for the response value</p> <p>6 With manual reset, resetting by disconnecting the power supply</p> <p>Type of terminals Without indication: terminal blocks fixed, with screw terminals PC (plug in cage clamp): pluggable terminal blocks with cage clamp terminals PS (plug in screw): pluggable terminal blocks with screw terminals</p> <p>Type</p>

Options with Pluggable Terminal Blocks



Screw terminal
(PS/plugin screw)




Cage clamp
(PC/plugin cage clamp)

Notes

Removing the terminal blocks with cage clamp terminals

1. The unit has to be disconnected.
2. Insert a screwdriver in the side recess of the front plate.
3. Turn the screwdriver to the right and left.
4. Please note that the terminal blocks have to be mounted on the belonging plug in terminations.

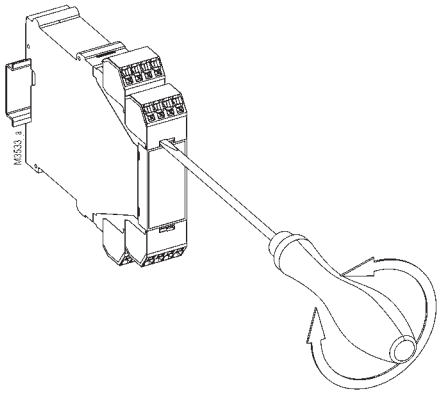

Accessories

AD 3: Remote potentiometer 470 K Ω
Article number: 0050174

Setting

Example:
Current relay BA 9053 / MK 9053N AC 0.5 ... 5 A

AC according to type plate:
i.e. the unit is calibrated for AC
0.5 ... 5 A = measuring range

Response value AC 3 A
Hysteresis AC 1.5 A


Settings
upper potentiometer: 0.6 (0.6 x 5 A = 3 A)
lower potentiometer: 0.5 (0.5 x 3 A = 1.5 A)

The AC - devices can also monitor DC current. The scale offset in this case is: $\bar{I} = 0.90 \times I_{\text{eff}}$

AC 0.5 ... 5 A is equivalent to DC 0.45 ... 4.5 A

Response value DC 3 A
Hysteresis DC 1.5 A

Settings
upper potentiometer: 0.66 (0.66 x 4.5 A = 3 A)
lower potentiometer: 0.5 (0.5 x 3 A = 1.5 A)

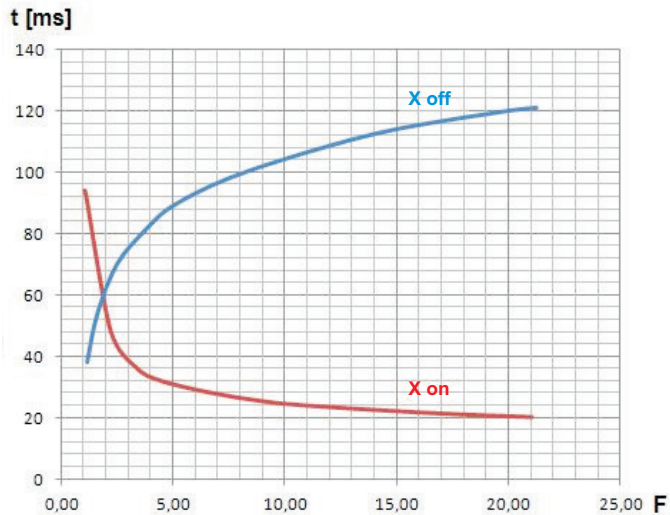

M11504 a

Time delay of measuring circuit

X on: Measured value rise $F = \frac{\text{Measured value (after rise of measured value)}}{\text{Setting value}}$

X off: Measured value drops $F = \frac{\text{Measured value (before measured value drops)}}{\text{Setting value (hysteresis)}}$

The diagram shows the typical delay of a standard devices depending on the measured values "X on and X off" at sudden rise or drop of the signal. At slow change of the measured value the delay is shorter. The total reaction time of the device results from the adjustable delay t_d and the delay created by the measuring circuit.

The diagram shows an average delay. The delay times could differ on the different variants.

Example for "X on" (overcurrent detection with BA9053/010):

Adjusted setting value X on = 2 A.

Due to a stalled motor the current rises suddenly to 10 A.

$$F = \frac{\text{Measured value (after rise of measured value)}}{\text{Setting value}} = \frac{10 \text{ A}}{2 \text{ A}} = 5$$

Reading from the diagram:

The output relay switches on after 31 ms at a setting $t_d=0$.

Example for "X off" (undercurrent detection with BA9053/012):

Adjusted hysteresis setting value is 10 A.

The current drops suddenly from 23 A to 0 A.

$$F = \frac{\text{Measured value (before measured value drops)}}{\text{Setting value (hysteresis)}} = \frac{23 \text{ A}}{10 \text{ A}} = 2.3$$

Reading from the diagram:

The output relay switches off after 70 ms at a setting $t_d=0$.